


HazLoc LED Luminaire

General Safety Information

- To reduce the risk of death, personal injury or property damage from fire, electric shock, falling parts, cuts/abrasions and other hazards, please read all warnings and instructions included with and on the fixture box and all fixture labels.
- Before installing, servicing, or performing routine maintenance upon this equipment, please follow these general precautions.
- Commercial installation, service and maintenance of luminaires should be performed by a qualified licensed electrician.
- DO NOT INSTALL DAMAGED PRODUCT!
- Make sure that the supply voltage is the same as the luminaire voltage.
- Do not install where the marked operating temperatures exceed the ignition temperatures of the hazardous atmosphere.
- Do not operate in ambient temperatures above those indicated on the luminaire nameplate.
- All gasket seals must be clean and undamaged.
- To ensure safety, a safety rope can be used to fix the luminaire before installation.

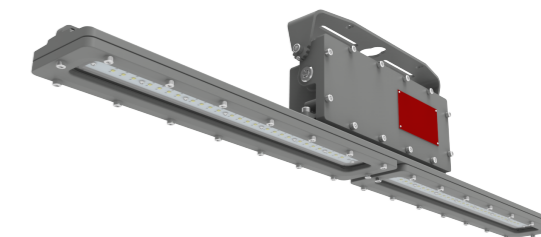

Picture is for illustration purpose only. Your model may vary

WARNING:

RISK OF ELECTRICAL SHOCK

- Turn off electrical power at fuse or circuit breaker box before wiring fixture to the power supply.
- Turn off the power when you perform any maintenance.
- Verify that supply voltage is correct by comparing it with the luminaire label information.
- Make all electrical and grounded connections in accordance with the National Electrical Code and any applicable local code requirements.
- All wiring connections should be capped with UL approved wire connectors.
- Luminaire must be supplied by a wiring system with an equipment grounding conductor.

CAUTION:

RISK OF INJURY

- Wear gloves and safety glasses at all times when removing luminaire from carton, installing, servicing or performing maintenance.
- Avoid direct eye exposure to the light source while it is on.
- Account for small parts and destroy packing material, as these may be hazardous to children.

CAUTION:

RISK OF FIRE

- Keep combustible and other materials that can burn away from luminaire and lamp/lens.
- MIN 90°C SUPPLY CONDUCTORS.

MODELLS:

LNT2-1-2-3-4-5-6-7-8

- 1= Wattage (30=30W;40=40W; 60=60W;80=80W)
- 2= Voltage (120-277=120-277Vac; 347-480=347-480Vac)
- 3= CCT(5K=5000K, 4K=4000K, 3K=3000K)
- 4= Beam(60= 60°; T2=Type II; 110=110°)
- 5= Rating (H1=C1D1/C1D2)
- 6= Lens (CG=Clear glass; DG=Diffuse glass)
- 7= Color (GRY=Grey)
- 8= Mounting (PND=Pendant; YKE=Yoke)

Operating characteristic:

- Rated Voltage: 120-277 Vac or 347-480 Vac, 50/60Hz
- Ambient Temperature Range: -40°F ~ 140°F (-40°C ~ 60°C)

Suitable for specific hazardous location per the NEC and CEC :

Hazardous Locations

Class I, Division 1, Groups C, D
Class I, Division 2, Groups A, B, C, D

Compliances

UL 844
UL 1598
UL 1598A
CSA C22.2 NO. 250.0:21, 5th Ed
CSA C22.2 No. 137, Edition: 2

Environmental Ratings

Suitable for wet location

Refer to the luminaire name-plate for specific classification information, maximum ambient temperature suitability and corresponding operating temperature (T-Code).

HazLoc LED Luminaire


Wiring

CAUTION: Turn off electrical power at fuse or circuit breaker box before wiring luminaire to the power supply.

Connecting panels to AC source supply: All units must be individually connected to the AC supply.

Black = Line
White = Neutral
Green = Ground

Dimming control wire: Yellow = Vaux 12V dc
Purple = Dim+ 1-10V input
Pink* = Dim- (NEG)

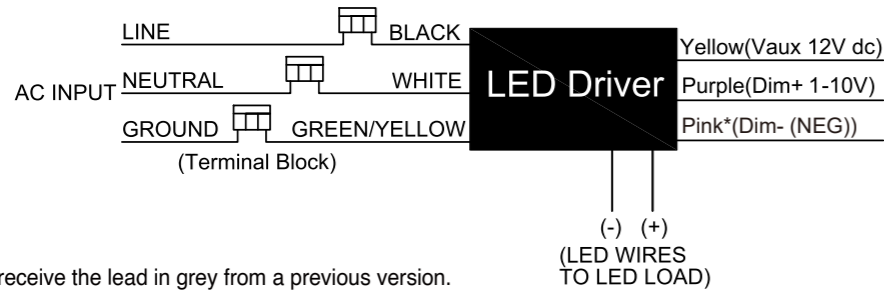


* You might receive the lead in grey from a previous version.

Installation


Electrical Connection:

1. Connect field supply wires to luminaire wire leads (or Wago connectors).
2. Wire per wiring diagram and per required electrical codes.
3. Close the driver housing, making sure that all wires are safely inside the box.
4. Check the tightness of conduit and Tank Cover.
5. Turn power on.

Product Dimensions

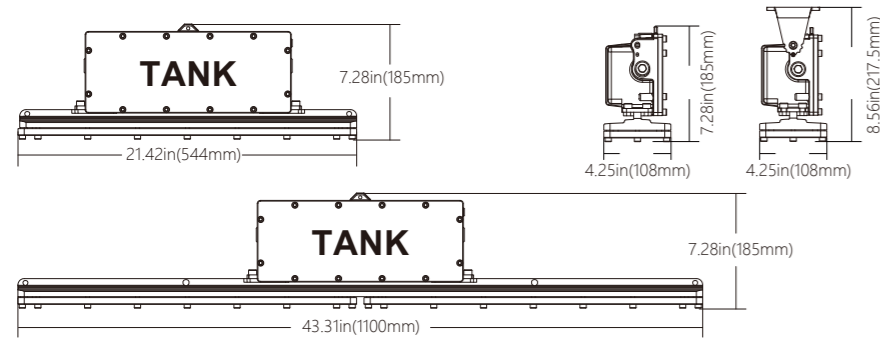

1. Pendant :

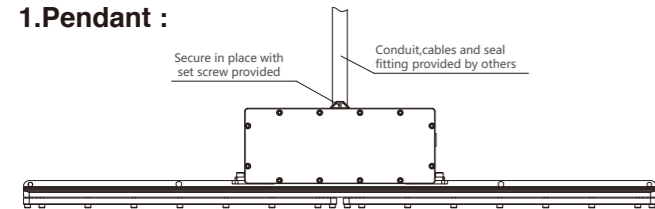

Step 1. Loosen the 12 (M6) hexagon socket head cap screws of the tank cover with torque value (7 N-m).

Step 2. Thread the fixture onto the NPT 3/4 inch conduit. Tighten the (M5) set-screw.

Step 3. Connect field supply wires to luminaire wire leads (or Wago connectors). Wire per wiring diagram.

Step 4. Close driver housing, making sure that all wires are safely inside driver box. Tighten 12 (M6) captive closing screw to (7 N-m).


Note: All installation must refer to Red Sky Lighting " NPT Assembly Instructions" to prevent water leakage.

HazLoc LED Luminaire

NPT Assembly Instructions:


STEP 1: Inspect port and fitting to ensure that both are free of contaminants and excessive burrs and nicks.

STEP 2: Apply a stripe of an anaerobic liquid pipe sealant around the male threads leaving the first two threads uncovered. If no liquid sealant is available, wrap Teflon tape (width of 12.7mm and thickness of 0.1mm) 2.5- 3 turns in a clockwise direction, viewed from the pipe end, leaving the rest two threads uncovered.

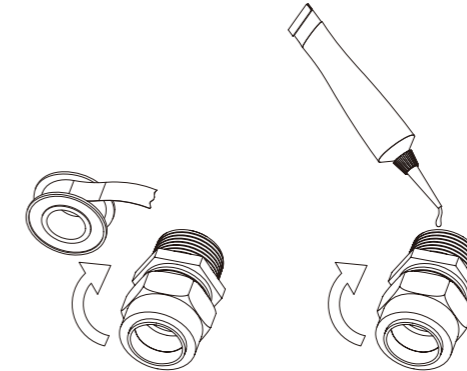


CAUTION: Teflon tape and some pipe sealants are destructive to hydraulic components. Always use extreme caution and follow manufacturer's recommendations for proper application of any sealant in order to prevent contamination.

STEP 3: Screw finger tight into the port

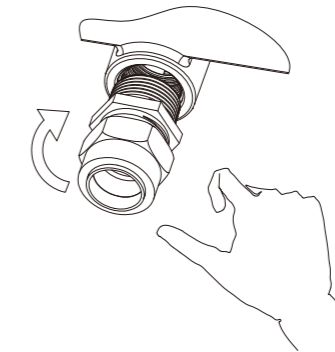

STEP 4: Wrench tighten the fitting to the correct Turns Past Finger Tight position. A properly assembled fittings total thread engagement should be 5 to 6 turns.

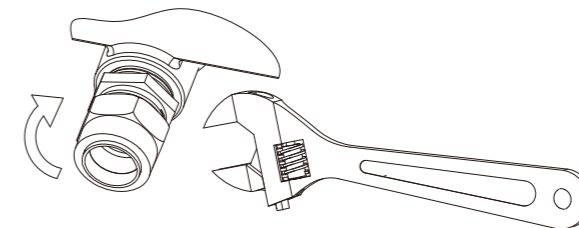

CAUTION: Never back off an installed pipe fitting to achieve proper alignment. Loosening installed pipe fittings will corrupt the seal and contribute to leakage and failure.
(*Applicable standard: ASME B1.20.1-2013)

HazLoc LED Luminaire

Servicing

- To avoid personal injury, disconnect power to the light and allow the unit to cool down before performing maintenance.
- Perform visual, electrical, and mechanical inspections on a regular basis. The environment and frequency of use should determine this. However, it is recommended that checks should be made at least once a year. Frequency of use and environment should determine this.
- The external glass should be cleaned periodically to ensure continued luminaire performance. Clean the glass with a clean, damp, non-abrasive, lint-free cloth. If this is not sufficient, use a mild soap or a liquid cleaner. Do not use an abrasive, strong alkaline or acid cleaner as damage may occur.
- Inspect the cooling fins on the luminaire to ensure that they are free of any contamination (i.e. excessive dust build-up). Clean with a non-abrasive cloth if needed.
- Mechanically check to make sure all parts are properly assembled.
- Electrically check to make sure that all connections are clean and tight.

Warranty

We warrant that each of our LED lighting luminaire (the "Product(s)") that are purchased while this Warranty is in effect will be free from defects in materials and workmanship for the period of time specified in the table below (the "Warranty Period"). The Warranty Period runs from the date of original purchase from its authorized distributor/dealer.

We will repair, or at our option, replace the defective product (exterior finish, housing and heat sinks, lens, LED engine, power supply) during the standard warranty period. This warranty applies only to the repair or replacement of the product and only when the product is properly handled, installed and maintained according to our instructions.

This warranty excludes defects resulting from improper installation, acts of God, fire, vandalism or civil disturbances, power surges or improper power supply, and corrosive environment installations.

This warranty does not cover equipment, systems or components from other manufacturers that the Purchaser uses in conjunction with the Product. Any repair, alteration or modification of the Product, including replacement of Product components with components of other manufacturers will void the warranty in its entirety.

| Product | Which Model Nos. are Covered by this Warranty | Warranty Period |
|----------------------|---|-----------------|
| HazLoc LED Luminaire | LNT2-XX-XXX | Five (5) Years |

HazLoc LED Luminaire

2.Yoke (Ceiling & Wall):

Step 1. Secure the yoke and fixture with appropriate fasteners directly to a structural member; Adjust the angle (6x30°) of the yoke and fix the position with M8 and M4 screws (provided), follow the steps, see fig 1a / 2a.


Step 2. Loosen the 12 (M6) hexagon socket head cap screws of the tank cover with torque value (7 N-m).

Step 3. Connect field supply wires to luminaire wire leads (or Wago connectors). Wire per wiring diagram.


Step 4. Close driver housing, making sure that all wires are safely inside driver box. Tighten 12 (M6) captive closing screw to (7 N-m).

Note: All installation must refer to Red Sky Lighting " NPT Assembly Instructions" to prevent water leakage.

Ceiling Mount

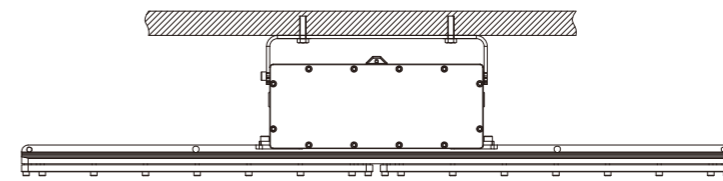

Wall Mount

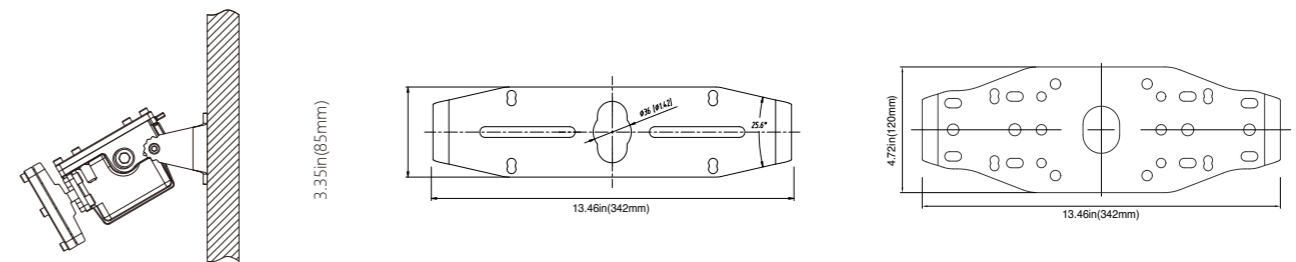

Steps of yoke installation:

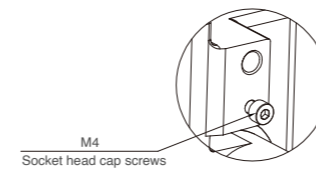


Fig.1a

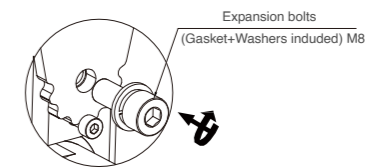


Fig.2a

Step 1: Install M4 socket head cap screws at both ends first, and reserve the distance of bracket

Step 2: Place the bracket and install the m8 bolts

HazLoc LED Luminaire

3. Pole (Pipe Clamp kit sold separately for pipe diameters of 1-7/8 in. or 2-3/8 in.):


Step 1. Check diameter of pipe to make sure you are using the correct size clamp.

Step 2. Place the Fixture yoke against the installed pipes.


Step 3. Place the clamp (U-bolts) on the pipe and fit it through the openings in the yoke.

Step 4. Adjust fixture to desired angle. Insert and tighten the supplied locking nuts and washers to secure the clamp to the pipe.

Note: All installation must refer to Red Sky Lighting " NPT Assembly Instructions" to prevent water leakage.

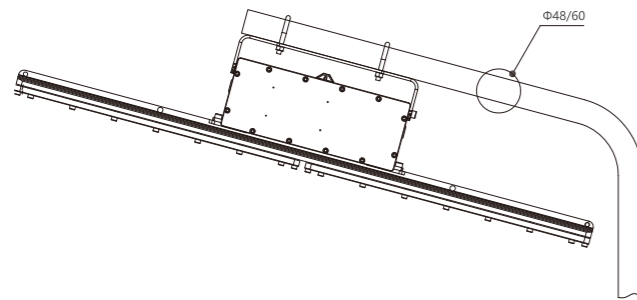

SAFETY CABLE INSTALLATION (kit sold separately)

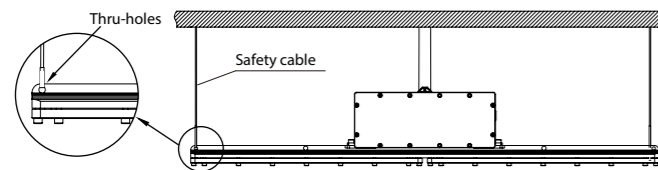

HazLoc LED Luminaire

INSTALLATION CHECKLIST


1. Verify if the steel pipe or cord grip are installed to at least five (5) full threads into the conduit entries of the fixture.



2. Verify field supply wires to luminaire (Wago connectors) per wiring diagrams and all electrical connections are tightened.



3. Verify all Wires are safely and neatly inside driver housing, Gasket of the housing is placed into the slot nicely and evenly.

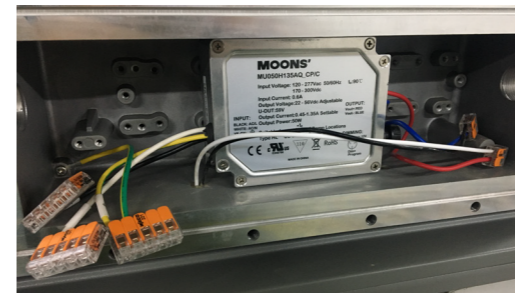

4. Verify captive closing screw is tightened to (7 N-m).



5. Follow Red Sky Lighting " NPT Assembly Instructions" to prevent water leakage.